

# VAMP 321

## Modular solutions for flexible arc flash protection



### Main characteristics

- **Modular structure**

The design of VAMP 321 allows insertion of new hardware which adds performance and functionality to the system. The unit, as specified in order codes on page 15, has two dedicated arc sensor inputs and is scalable from standard to high-end arc flash protection systems.

- **PC configurable**

The system can be configured by the end-user with the VAMPSET software tool. Events and disturbance recordings are easily evaluated using a PC with USB connection.

- **Event logs and disturbance recording**

Vamp introduces event and disturbance functionality in an arc protection system to enhance the pre and post fault analysis of the arc phenomena.

- **Compatible with existing systems**

The VAMP 321 relies on the same VAM I/O units, cabling and sensors as the company's other renowned arc flash protection systems.

- **Engineered for the most demanding environments**

The new mechanical structure comprises a robust cast aluminium casing. Adjustable fixtures provide flexible installation to every power system environment. IP54 protection is achieved when flush mounted.

- **Proven technology**

Developed in close cooperation with customers, the VAMP 321 combines the reliable technology of Vamp's 50 and 200 series and that of the VAMP 221 arc flash protection system.

- **Communication**

The VAMP 321 has five communication ports, four of which are intended for a SCADA interface. Supported protocols are IEC 61850, Profibus DP, Modbus TCP, DNP TCP, Modbus RTU, SPA, IEC 60870-5-101 and IEC 60870-5-103.

Modern society heavily depends on an uninterrupted supply of electric power. Prolonged power outages cause loss of business to the power supplier and loss of production to the power consumer. Regardless of how safe a power system is, faults do occur.

An arc flash protection relay is a protective device used to maximise the safety of personnel and minimise the damage to the installation in the most hazardous power system fault situations.

Fast arc flash protection increases operator safety in case of an arc fault occurring in switchgear.

The faster the operating time of the protection system, the lesser the damage caused by the arc fault will be.



Schneider Electric's Vamp range is the pioneer in the field of arc flash protection with close to 15,000 arc flash systems and 300,000 sensors in service worldwide.

The new VAMP 321 system is designed with user-friendliness in mind

# Why arc flash protection?

When traditional time-grading or blocking based protection coordination principle is used, it may not provide fast enough protection of substation faults. Further, high-impedance type earth-faults may cause prolonged operation times of earth-fault relays leading to the significant release of arcing energy.

These facts pose a considerable risk to operation personnel and economical assets.

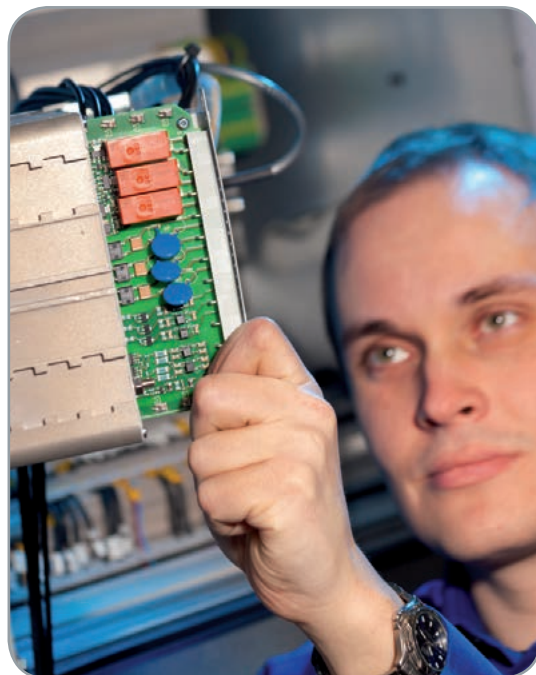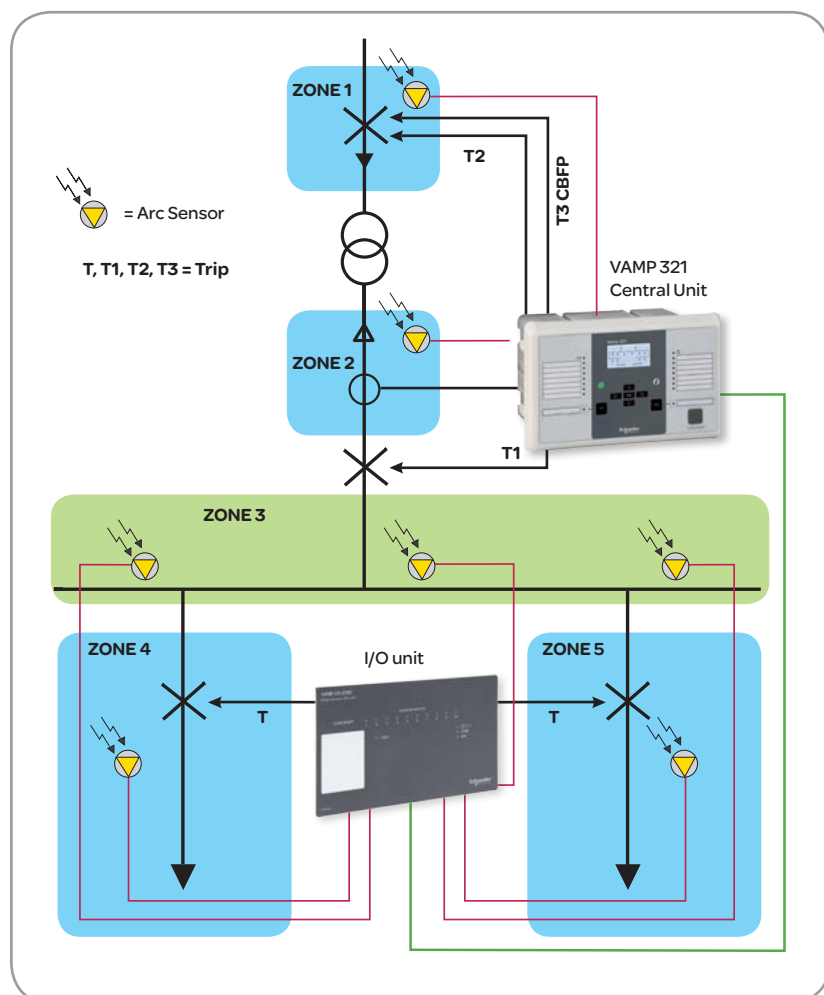

## Build your own protection IED suitable to your application


User may decide the hardware and software of the unit with the order code. Various I/O modules and communication options bring more flexibility to the protection application.

### Inputs and outputs

Modularity ensures a wide range of DI / DO combination as per customer demand.

The table shows number of DI / DO for few optional module combinations. Maximum amount of DI can be 40 pcs and DO 22 pcs but not at a same time.

Inputs and outputs combination examples							
DI (pcs)	31	30	26	22	18	16	12
DO (pcs)	14	10	10	14	18	10	14

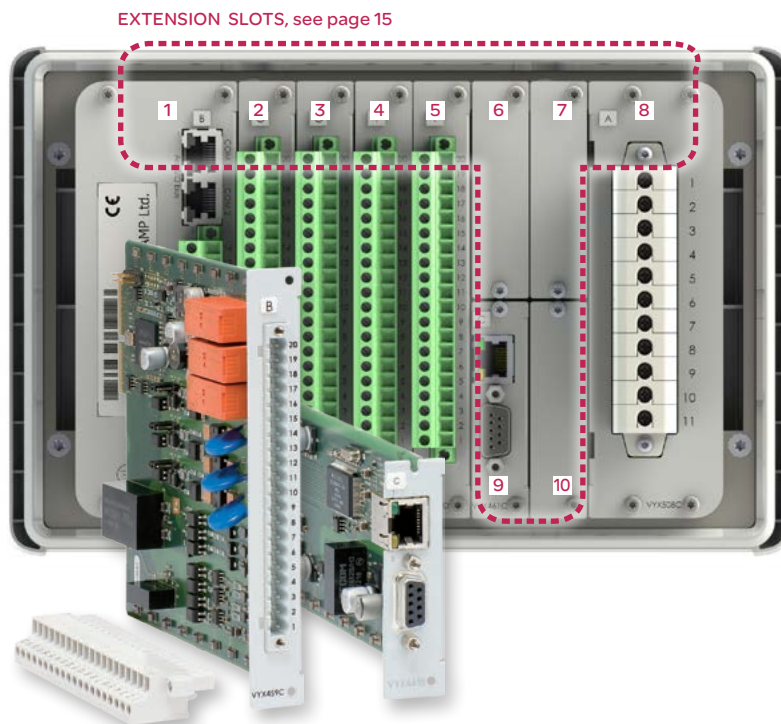

## Detachable HMI brings more flexibility

Order options provide two alternative mounting principles to VAMP 300 IED. Both options have its own advantages.

### Panel mounting

The conventional mounting technique has always been installing the IED on the secondary compartment's door. Limitation in this approach could be that the door construction is not strong enough for the IED's weight and suitability to wire large amount of secondary and communication cabling could be challenging.

### Wall mounting with detachable HMI

This mounting technique allows door being lighter as the relays frame is installed in the back of the secondary compartment. Normally, the IED in this mounting principle is by the terminal blocks, hence the secondary wiring is short. Communication cabling is easier, too, as the door movement does not need to be considered. In this case, only the communication between IED base and display has to be wired.



# VAMPSET setting and configuration tool


VAMPSET is a user-friendly, free-of-charge relay management software for setting parameters and configuring VAMP relays. Via the VAMPSET software, relay parameters, configurations and recorded data can be exchanged between PC and VAMP relays. Supporting the COMTRADE format, VAMPSET also incorporates tools for analysing relay events, waveforms and trends from data recorded by the relays, e.g. during a network fault situation.




Standard USB communication cable can be used.

Using a standard USB communication cable, the PC running VAMPSET connects to the front port of the VAMP relays. The VAMPSET software also supports TCP/IP communication via an optional port. Featuring true multi-language support the software runs on Windows environment without any need for configuration of the PC.

The VAMPSET software is future-proof, supporting future updates and new VAMP products.

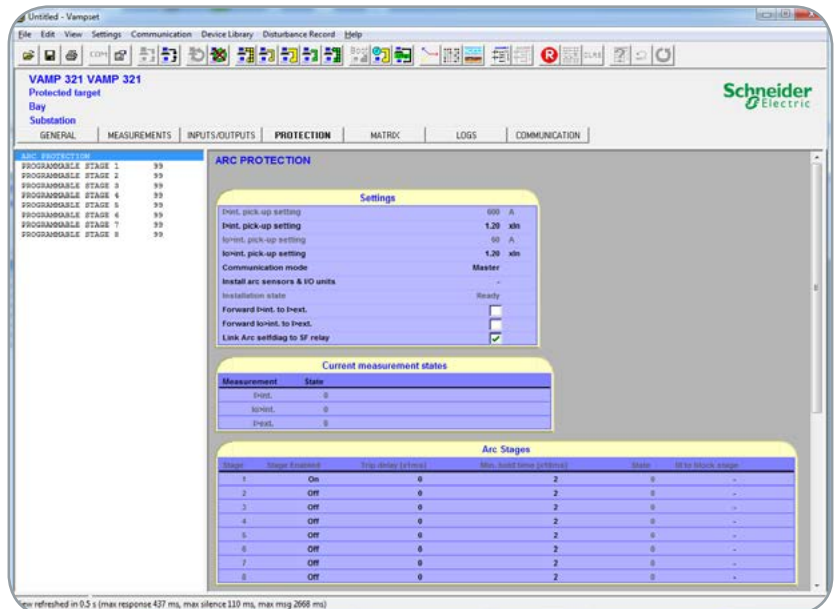


The device's setting views are organised to several folders in the VAMPSET setting tool views in order to conveniently find right data for parameterisation of the IED. The setting tool displays main menu of the arc protection.

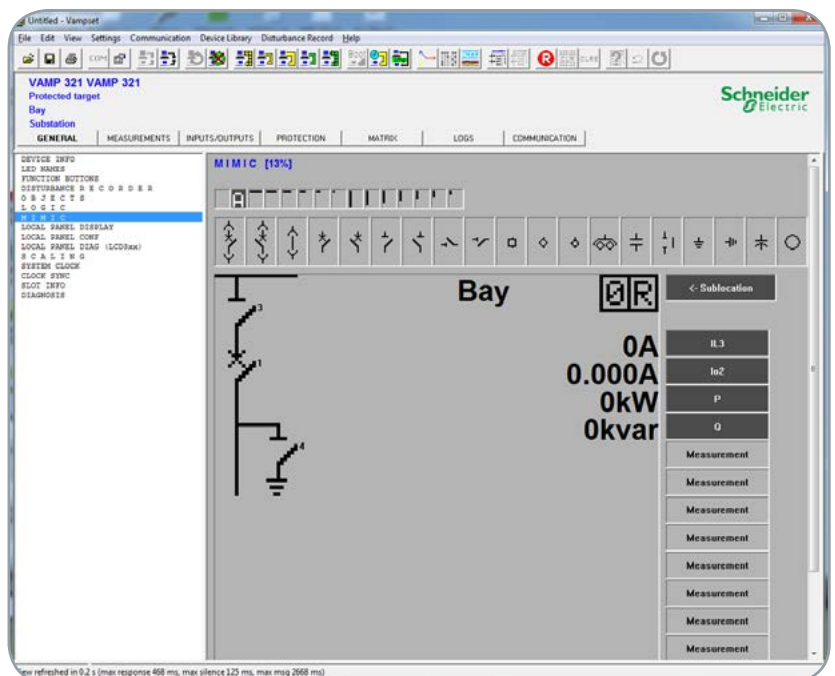

HMI can be freely configured to show desired mimic and measurements as well as control functions.

# Programmable stages

There are now eight stages available to use with various applications. Each stage can monitor any analogue (measured or calculated) signal and issue start and trip signals. Programmable stages extend the protection functionality of the manager series to a new level. For example, arc flash protection master unit can be used as back-up protection for conventional O/C relay.

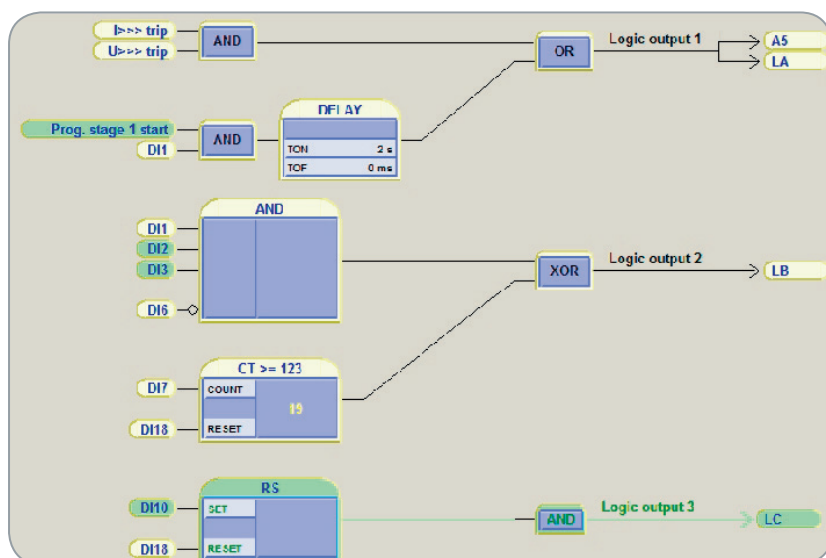

## Programmable logic:

The logic editor has colours to enable viewing of active statuses. Furthermore, each input status can be also seen on-line in VAMPSET view.

### PROGRAMMABLE STAGE 1

Enable for Prg1	<input checked="" type="checkbox"/>
Priority	20 ms
Programmable stage 1 status	-
Enable forcing	<input type="checkbox"/>

Coupling	THDIL1
THDIL1	10.0 %
Compare condition	>

Set group DI control	-
Group	1
Pick-up setting	15.0 %
Pick-up setting	15 %
Operation delay	0.50 s

	Group 1	Group 2
Pick-up setting	15.0 %	100.0 %
Pick-up setting	15 %	100 %
Operation delay	0.50 s	0.50 s

Hysteresis	3.0 %
No compare limit for mode <	0 %

### PROGRAMMABLE STAGE 1 99

Enable for Prg1	<input checked="" type="checkbox"/>
Priority	20 ms
Programmable stage 1 status	Trip
Enable forcing	<input type="checkbox"/>

Timebase for input value A	Instant
Coupling A	IL1
IL1	50 A
Timebase for input value B	Instant
Coupling B	IL2
IL2	37 A
Compare condition	Diff

Set group DI control	-
Group	1
Pick-up setting	0.00 A
Pick-up setting	0.00 A
Operation delay	0.50 s

	Group 1	Group 2
Pick-up setting	0.00 A	1.20 A
Pick-up setting	0.00 A	1.20 A
Operation delay	0.50 s	0.50 s

Hysteresis	3.0 %
No compare limit for mode <	0.00 s


Programmable stage has a possibility to compare two freely selectable signals between each other. Using this feature the user can create compare function using relay's own measured or calculated signals. One or both of the signals can be connected to comparison function over GOOSE.



# Communication

VAMP is a communication expert with a wide experience in interfacing with different system integrators' and SCADA suppliers' RTUs, PLCs, gateways etc. using many different protocols. Flexible adaptation of the communication protocols together with powerful and easy to use software tools are the key of successful integration.

VAMP 300 IED and the VAMPSET tool provide access to practically any power system information you may need.

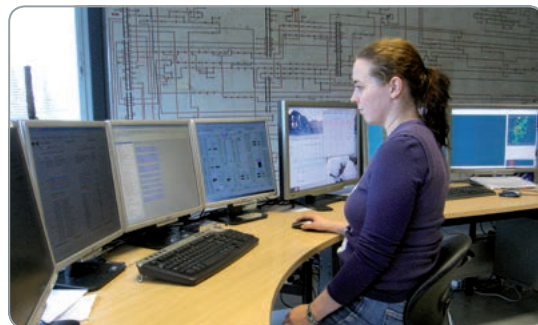

## Native IEC 61850

The IEC 61850 protocol can be used to read or write static data or to receive events sent spontaneously from the relay. In addition, the interface allows peer-to-peer communication between the relays, called GOOSE communication. The IEC 61850 interface is configured with familiar, user-friendly VAMPSET software.

The IEC 61850 datamodel, data-sets, report control blocks and the GOOSE communication are configured according to the requirements of the system configuration. VAMPSET is also used to produce ICD files, which may be needed for the substation RTU configuration

The VAMP 300 IED contains native implementation, which means that the IEC 61850 functionality is embedded in the software.

## Communication matrix

Check which physical interface matches with certain protocols. It is possible to expand RS-232 interface with external hardware modules


	None	DeviceNet	External I/O: Modbus	IEC-101	IEC-103	Modbus RTU	Profibus DP	SpaBus	Ethernet/IP	IEC-61850	Modbus TCP	DNP 3.0	GetSet
RS-232	●	●	●	●	●	●	●	●	●	●	●	●	●
RS-485	●	●	●	●	●	●	●	●	●	●	●	●	●
Ethernet	●	●	●	●	●	●	●	●	●	●	●	●	●
Profibus	●	●	●	●	●	●	●	●	●	●	●	●	●
Serial fiber	●	●	●	●	●	●	●	●	●	●	●	●	●
Devive Net	●	●	●	●	●	●	●	●	●	●	●	●	●
Profibus	●	●	●	●	●	●	●	●	●	●	●	●	●
RS-485	●	●	●	●	●	●	●	●	●	●	●	●	●

# Control

## Circuit breaker (object) control

→ F1/ F2 buttons


Another way to control circuit breaker or isolators is to program Function button F1 and F2 to execute the control command. Once programmed F1 could be the close and F2 open command. A dedicated info view appears on the HMI requesting confirmation or de-selection of the action.

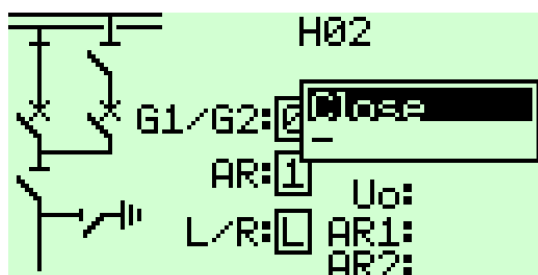

# Selective and flexible arc flash protection solutions for low and medium voltage systems

Modern motor control centers (MCC) equipped with arc flash protection provide ultra-fast arc protection for the switchgear, limiting the possible arc flash fault to a minimum.

The point sensors give an accurate location of the fault thus the required repair for the MCC's is fast and the power can be restored without fault location time delay. The central unit trips both the incoming LV circuit breaker and the circuit breaker up-stream. The nature for an arc flash fault can be fuse, cable termination, contactor or circuit breaker feeding the motor in the MCC, therefore fast fault location is extremely useful.


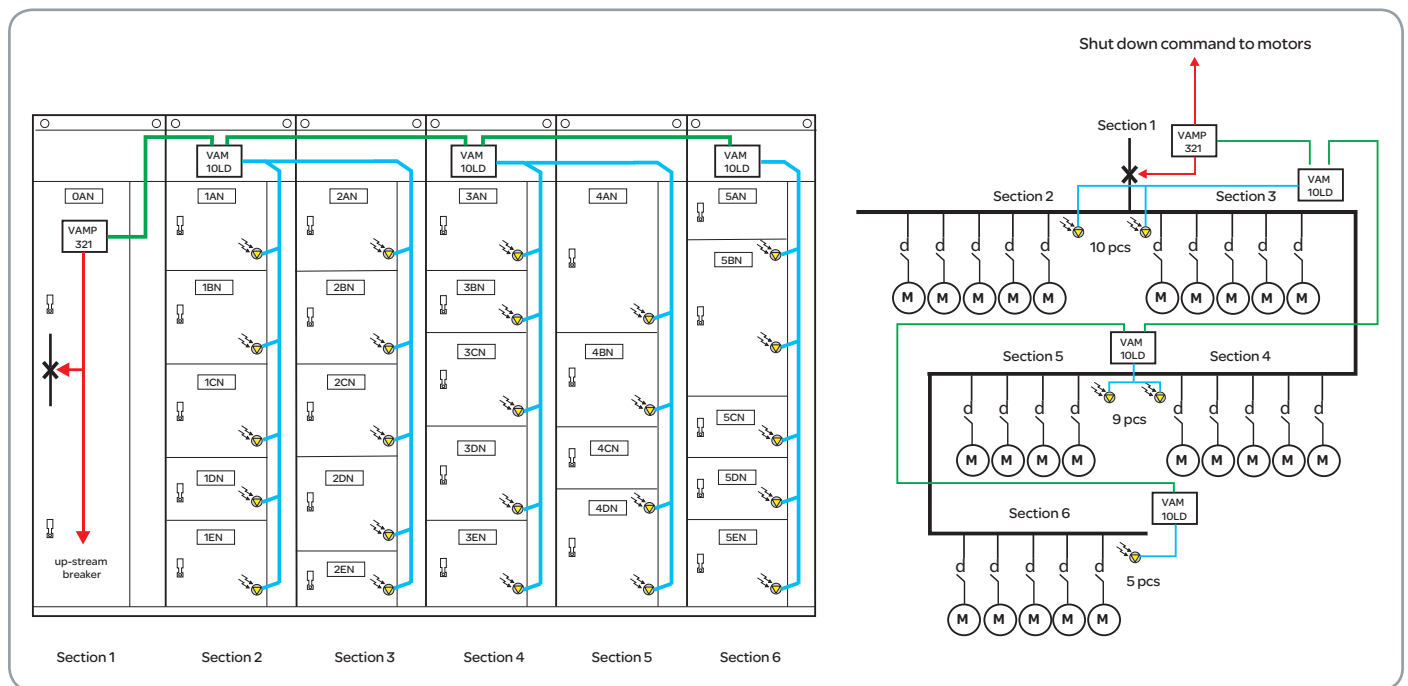


## Various solutions for any medium or low voltage arc protection application


- The VAMP arc protection system can be built using various components of the VAMP relay family.
- The system has been designed to cover basic level and demanding applications of the low and medium voltage power distribution system.
- VAMP arc protection system and relay products can be combined to obtain an arc protection scheme for any application.



The arc sensor I/O units incorporate a snap-in connector for the portable sensor. The activated arc sensor channel is indicated with a led.

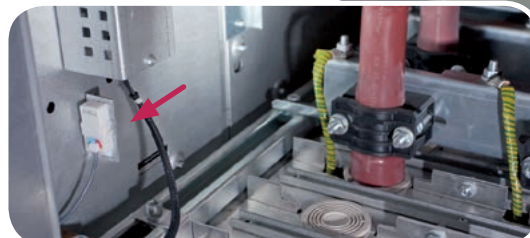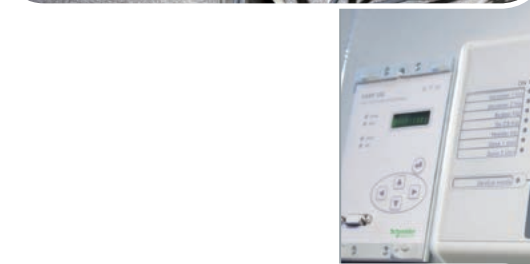

The majority of arc faults occur in the cable compartment hence it is a natural location for the point sensor.

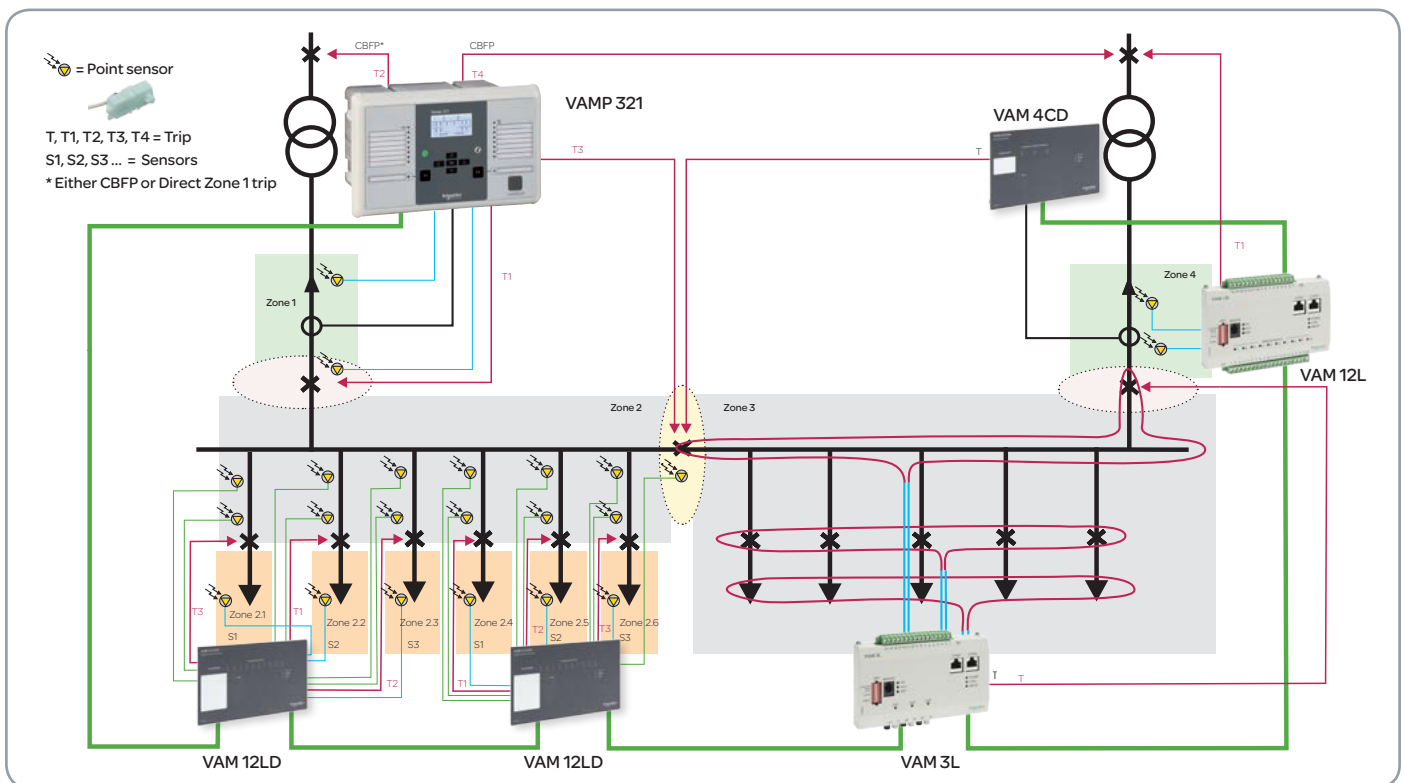

The selectivity requirement of the arc flash protection is dependent on the switchgear construction and the importance of the power distribution. The more important the supplied power, the more selective arc flash protection scheme is implemented.

**The left side of the medium voltage switchgear**, as seen in the picture, has various protection zones. Cable termination has its own zone and is tripped should the fault occur in the cable compartment.

One VAM 12LD unit is able to trip up to three sub-zones selectively.

Point sensors are mounted in the switchgear's pressure relief compartment in this installation.



**The circuit breaker and busbar compartments** belongs to another zone supervised by the VAM 12LD units.

As the distribution system does not have current measurement on the high voltage side of the power transformer, the arc flash protection system uses the current status from low voltage side. In this case the zone 1 selectivity is set up by light only criteria and the zone is fully isolated should the fault occur.

**The right side of the switchgear** has a universal one zone scheme for the cable, circuit breaker and bus bar compartments using three fibre sensor loops. The incoming cable termination compartment is based on the light only protection principle.



Arc protection systems require three phase currents for selective high-speed arc protection. Using the zero-sequence voltage and current in tripping criteria, the arc fault trip can be activated before the fault is completely exposed.




# Characteristics and highlights of the VAMP 321 arc protection system

## VAMP 321 arc protection system central unit



- 3-phase current, zero-sequence current and voltage
- Event logs, disturbance recording and real-time clock
- High speed output, HSO: 2 ms (typically)
- Trip contact, T: 7 ms typically
- Operation on simultaneous current and light or on light only
- Informative display
- Communication with SCADA
- Four normally open trip contacts (option)
- One normally open and one change over alarm contact
- Programmable operation zones
- Continuous system self-supervision
- Circuit breaker failure protection (user configurable)

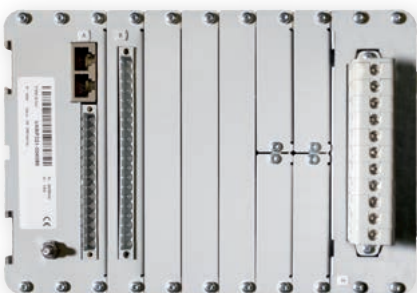

The auxiliary supply, CT wiring, trip and alarm outputs as well as modular cables are connected to the rear side of the central unit.

## VAMP 321 arc protection system

- Auxiliary supply and communication via modular cable
- Continuous supervision of sensors
- Connection of portable arc sensor, except VAM 4C and VAM 4CD
- Indication of arc sensor / current channel and trip relay activation

## VAM 4C, VAM 4CD current I/O unit



- Auxiliary supply and communication via modular cable
- 3-phase current measurement or 2-phase and zero-sequence current measurement
- Adjustable pick-up setting
- Indication of the current channel pick-up, current imbalance and trip relay activation
- One trip relay
- Two communication ports for central unit and I/O unit interconnection

### VAM 4CD - Additional features to VAM 4C

- Labelling for customised arc sensor channel text
- Flush mounting
- HMI indication available on door closed position

## VAM 3L, VAM 3LX fibre sensor I/O unit



- Auxiliary supply and communication via modular cable
- Three supervised fibre loop arc sensor connections
- Connection of portable arc sensor
- Indication of the sensor channel and trip relay activation
- One trip relay
- Two communication ports for central unit and I/O unit interconnection

### VAM 3LX - Additional features to VAM 3L

- Fibre arc sensor sensitivity adjustment

### VAM 10L, VAM 10 LD point sensor I/O unit



- Auxiliary supply and communication via modular cable
- Ten (10) point arc sensor connections
- Continuous supervision of sensors
- Connection of portable arc sensor
- Indication of the sensor channel and trip relay activation
- One trip relay
- Two communication ports for central unit and I/O unit interconnection

#### VAM 10LD - Additional features to VAM 10L

- Labelling for customised arc sensor channel text
- Flush mounting
- HMI indication available on door closed position

### Selection table for VAM I/O units

	VAM 3L	VAM 10L	VAM 10LD	VAM 12L	VAM 12LD	VAM 4C	VAM 4CD
Mounting	DIN rail	DIN rail	Door	DIN rail	Door	DIN rail	Door
No. of point sensors		10	10	10	10		
No. of loop sensors	3						
No. of protection zones supported	1	1	1	4	4		
No. of trip contacts	1	1	1	3	3	1	1
No. of alarm contacts				1	1		
No. of current inputs						3	3
No. of BI (24-48Vdc)*	1	1	1				
No. of BI (24-48Vdc) L>						1	1
No. of BO (24Vdc) trip	1	1	1			1	1
No. of sensor channel indication (LED)	3	10	10	10	10	3	3
Connection for portable sensor	1	1	1	1	1		
Other			(*)		(*)		(*)

\* Used for zone shift 1 <--> 2 and 3 <---> 4

(\*) Text pocket for setting values

### DI control for zone shift

	Active zone			
BI channel state	1	2	3	4
Not active	x		x	
Active		x		x

Used for VAM 10L, VAM 3L and VAM 3LX

### VAM 12L, VAM 12LD point sensor I/O unit



- Three selective trip output contacts for dedicated sensors
- Auxiliary supply and communication via modular cable
- 10 point arc sensor connections
- Continuous supervision of sensors
- Connection of portable arc sensor
- Indication of the sensor channel and trip relay activation
- Two communication ports for central unit and I/O unit interconnection

#### VAM 12LD - Additional features to VAM 12L

- Flush mounted unit
- HMI indication available on door closed position
- Labelling for customised arc sensor channel text



Door mounted I/O units show arc protection system information without opening the secondary compartment door

In case the central unit is located close to the I/O units, the I/O units can be placed in the secondary equipment compartment.



# Sensors and accessories

## Point sensors

- Easy installation and replacement
- Enables fault location indication
- Surface mounting
- Tube mounting
- Continuous self-supervision



## Fibre ARC-SLm sensors

- Standard fibre
- Length from 1 to 70 meters
- Self-supervision
- Cost effective when many compartments



### ARC-SLm

- Activation 8,000 lx
- Multicore cable
- 10 mm bending radius minimum

## Sensor mounting plates

- Z- or L-shaped
- Wall mounting to VA1DA-x sensors (no extra holes in the switchgear)



Note 1: X = cable length (m)

Note 2: X = fibre length (m)

For more details, see accessories page 12.

## Portable sensor VA1DP

- Provides additional detection of arc flash
- Quick connection with snap-in socket



### Portable sensor VA1DP-5

- Snap-in socket connection to sensor I/O unit



### Portable sensor VA1DP-5D

- Snap-in socket connection to sensor I/O unit via VX031-5 cable



### VX031-5 Extension cable

- Extension cable and door socket for VA1DP-5D
- Diplexer for two portable sensors


## Modular cable VX001-x



- Transfers all information and aux. supply between VAMP 321 and I/O unit or between I/O units, simple wiring with RJ 45 connector
- Used for switchgear shipping splits,

## VAMP 4R trip multiplier relay

- 4 + 4 trip outputs (4 x NO and 4 x NC)
- Two separate tripping groups
- Enables a 7 ms total operation time to a large number of CBs controlled by binary output (BO)
- Requires external auxiliary power supply

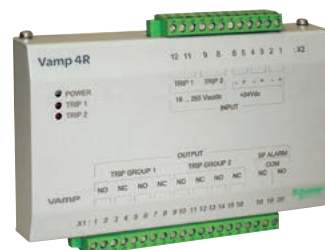


## Projection mounting


In case the depth dimension behind the compartment door is limited, the IED can be equipped with frame around the collar. This arrangement reduces depth inside compartment by 45 mm.




# Dimensional drawings

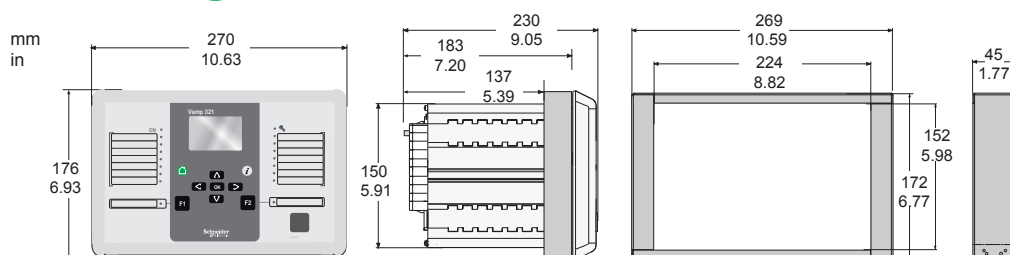


## Panel mounting

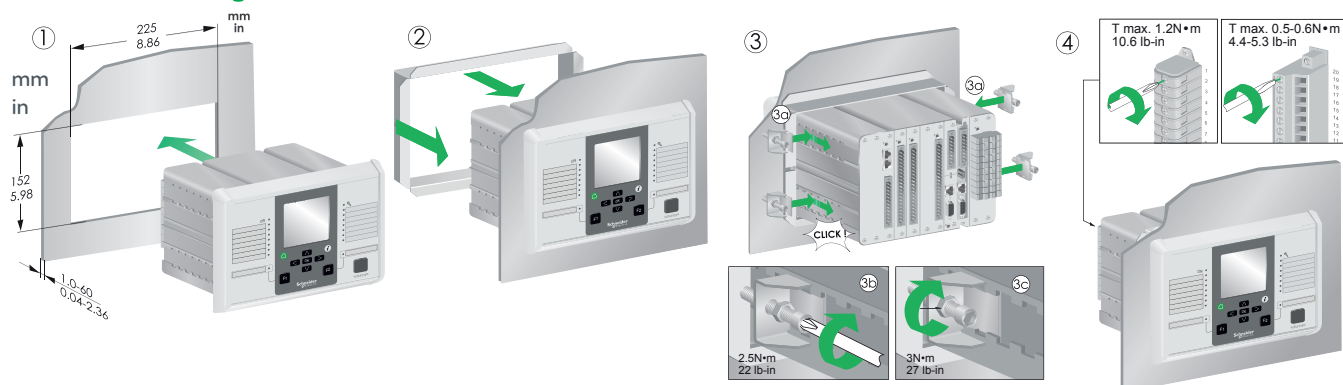


## Projection mounting

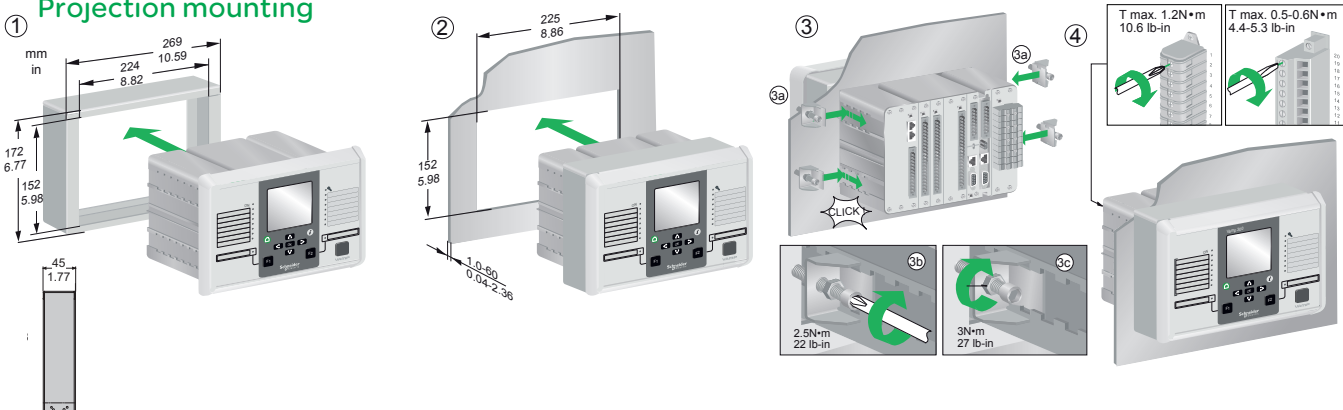


## Wall mounting with detachable HMI

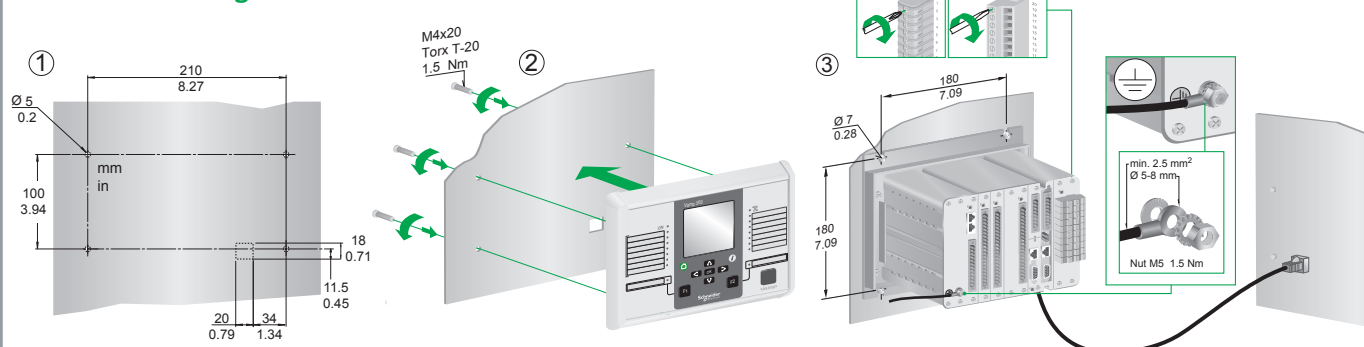

## VAM 10L, 3L, 4C and VAMP 4R

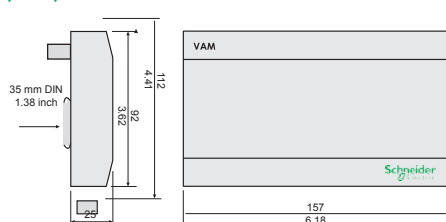

## VAM 4CD, 10 LD, 12LD flush mounting

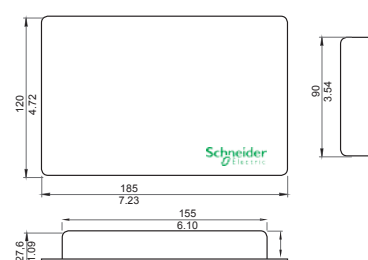

# Technical data

## VAMP 321 system

Power supply	
Vs	110 – 240 $\pm$ 10% V ac/dc 110/120/220/240 V ac 110/125/220 V dc or 24 – 48 $\pm$ 20% V dc 24/48 V dc
Measuring circuits	
Rated current I <sub>N</sub> Burden	5 A (configurable for CT secondaries 1 – 10 A) < 0.2 VA
Rated current I <sub>Q</sub> Burden	5 A / 1 A (optionally 1 A / 0.2 A) < 0.2 VA
Rated voltage U <sub>N</sub> Burden	100 V (configurable for VT secondaries 50 – 120 V) < 0.5 VA
Rated frequency f <sub>N</sub>	45 – 65 Hz
Operating settings	
Phase current stage IL>	0.5 – 8.0 x I <sub>N</sub>
Earth-fault current Io>	0.1 – 5.0 x I <sub>N</sub>
Tripping outputs	
Number of contacts	As per order code
Rated voltage	250 V ac/dc
Continuous carry	5 A
Make and carry for 0.5 s	30 A
Make and carry for 3 s	15 A
Contact material	AgNi 90/10
Operating time (trip contact)	7 ms
Operating time (HSO)	2 ms
Signal outputs	
SF output contact	1 pc change over
Signal contact	1 pc NO
Rated Voltage	250 V ac/dc
Continuous carry	5 A
Contact material	AgNi
BIO inputs/outputs, slot 2 option B	
Rated output voltage	+30 V dc
Rated input voltage	+18 – 265 Vdc
Rated current (BO)	20 mA
Rated current (BI)	5 mA
BI line (IN)	3 pcs
BO lines (OUT)	3 pcs
BIO inputs/outputs, slot 2 option C	
Connector	ST
Fibre	50/125 $\mu$ m, 62.5/125 $\mu$ m, 100/140 $\mu$ m, and 200 $\mu$ m
Max link distance	2 km (62.5/125 $\mu$ m)
Max link attenuation	7 db
BI line (IN)	2 pcs
BO lines (OUT)	2 pcs
Arc I/O bus (RJ-45)	
Multi drop	Max 16 slaves and 3 masters
Supply to slaves	Isolated 24 V dc
Communication (master-slave)	RS485 information / self supervision
ARC / OC signal master-slave	4 zone ARC and 1 zone OC line
Arc sensor inputs	
Direct inputs	As per order code
Supply to sensor	Isolated 12 V dc

## VAM I/O units

TRIP contacts		
Rated voltage	250 V ac/dc	
Continuous carry	5 A	
Make and carry for 0.5 s	30 A	
Make and carry for 3 s	15 A	
t>	7 ms	
Digital inputs		
Rated voltage	24 V dc	
Rated current	5 mA	
Digital outputs		
Rated voltage	24 V dc	
Rated current	20 mA ( max )	
VAM 10L / 10LD / 12L / 12LD		
	VAM 10L / LD	VAM 12L / LD
No. of trip contacts	1	3
No. of digital inputs	1	
No. of digital outputs	1	
No. of arc sensor channels	10 pcs	
Power supply	+24 V dc via modular cable or terminals	
Power consumption, In (stand-by)	45 mA	
Power consumption per activated channel I sensAct	20 mA	
Total power consumption	45 mA + ( n* x I sens Act)	
VAM 3L, VAM 3LX		
No. of trip contacts	1	
No. of digital inputs	1	
No. of digital outputs	1	
No. of fibre loops	3 pcs	
Power supply	+24 V dc via modular cable or terminals	
Power consumption, In (stand-by)	45 mA	
Power consumption per activated channel I sensAct	20 mA	
Total power consumption	45 mA + ( n* x I sens Act)	
VAM 4C / VAM 4CD		
No. of trip contacts	1	
No. of digital inputs	1	
No. of digital outputs	1	
Measuring circuits		
Rated current In	1 A / 5 A	
Rated frequency fn	45 – 65 Hz	
Power consumption	≤ 0.3 VA	
Thermal withstand	60 x In for 1 s	
Operating settings		
Phase current stage IL>	0.5 – 6.0 x IN	
Earth-fault current Io>	0.05 – 5.0 x IN	
Accuracy	± 5 %	
Reset ratio	0.95	


VAMP 4R trip multiplier relay

Power supply	24 V dc
Control signal	18 – 265 V ac/dc
Tripping contacts	4 pcs NO, 4 pcs NC
Rated voltage	250 V ac/dc
Continuous carry	5 A
Make and carry for 0.5s	30 A
Make and carry for 3s	15 A
Contact material	AgNi
Number of tripping groups	2

# Tests and environmental

Disturbance tests		Standard & Test class / level	Test value
<b>Emission</b> - Conducted - Emitted	EN 61000-6-4 / IEC 60255-26 EN 55011, Class A / IEC 60255-25 EN 55011, Class A / IEC 60255-25 / CISPR 11	0.15 – 30 MHz 30 – 1 000 MHz	
<b>Immunity</b> - 1Mhz damped oscillatory wave - Static discharge (ESD) - Emitted HF field - Fast transients (EFT) - Surge  - Conducted HF field - Power-frequency magnetic field - Pulse magnetic field - Voltage interruptions - Voltage alternative component - Voltage dips and short interruptions	EN 61000-6-2 / IEC 60255-26 IEC 60255-22-1 EN 61000-4-2 Level 4 / IEC 60255-22-2 Class 4 EN 61000-4-3 Level 3 / IEC 60255-22-3 EN 61000-4-4 Level 4 / IEC 60255-22-4 Class A EN 61000-4-5 Level 4 / IEC 60255-22-5  EN 61000-4-6 Level 3 / IEC 60255-22-6 EN 61000-4-8 EN 61000-4-9 Level 5 EN 61000-4-29 / IEC 60255-11 EN 61000-4-17 / IEC 60255-11 EN 61000-4-11	± 2.5 kVp CM, ± 2.5 kVp DM ± 8 kV contact, ± 15 kV air 80 - 2700 MHz, 10 V/m ± 4 kV 5/50 ns, 5 kHz ± 4 kV, 1.2/50 µs, CM 2 kV, 1.2/50 µs, DM 0.15 - 80 MHz, 10 Vemf 300 A/m (continuous), 1000 A/m 1–3 s 1000 A/m, 1.2/50 µs 30 %/1 s, 60 %/0.1 s, 100 %/0.05 s 12 % of operating voltage (DC) / 10 min 30%/10 ms, 100%/10 ms, 60%/100 ms, >95 %/5000 ms	
Electrical safety tests			
- Impulse voltage withstand - Dielectric test - Insulation resistance - Protective bonding resistance - Power supply burden	EN 60255-5, Class III EN 60255-5, Class III EN 60255-5 EN 60255-27 IEC 60255-1	5 kV, 1.2/50 µs 2 kV, 50 Hz > 100Mohm, 500 V / 100 V < 0.1 ohm > 20 W internal	
Mechanical tests			
<b>Device in operation</b> - Vibrations - Shocks <b>Device de-energized</b> - Vibrations - Shocks - Bump	IEC 60255-21-1, Class II / IEC 60068-2-6, Fc IEC 60255-21-2, Class II / IEC 60068-2-27, Ea  IEC 60255-21-1, Class II / IEC 60068-2-6, Fc IEC 60255-21-2, Class II / IEC 60068-2-27, Ea IEC 60255-21-2, Class II / IEC 60068-2-27, Ea	1Gn, 10Hz – 150 HZ 10Gn/11 ms  2Gn, 10 Hz – 150 HZ 30Gn/11 ms 20 Gn/16 ms	
Environmental tests			
<b>Device in operation</b> - Dry heat - Cold - Damp heat, cyclic - Damp heat, static <b>Device in storage</b> - Dry heat - Cold	EN / IEC 60068-2-2, Bd EN / IEC 60068-2-1, Ad EN / IEC 60068-2-30, Db EN / IEC 60068-2-78, Cab  EN / IEC 60068-2-2, Bb EN / IEC 60068-2-1, Ab	+70°C -40°C From +25°C to +55°C, From 93% RH to 98% RH, 6 days +40°C, 93% RH, 10 days  +70°C -40°C	
Environmental conditions			
<b>Ambient temperature, in-service</b> <b>Ambient temperature, storage</b> <b>Relative humidity</b> <b>Maximum operating altitude</b> <b>Degree of protection (IEC 60529)</b> <b>Weight</b> <b>Dimension (W x H x D)</b>	-40 – +65°C -40 – +70 °C < 95%, no condensation allowed 2000 m IP54 (from front when panel mounted) 3.2 kg or higher (depends of options) 270 x 176 x 230 mm		
Package			
<b>Dimensions (W x H x D)</b> <b>Weight (IED, Package and Manual)</b>	315 x 210 x 257 mm 4.2 kg or higher (depends of options)		

# VAMP 321 order codes

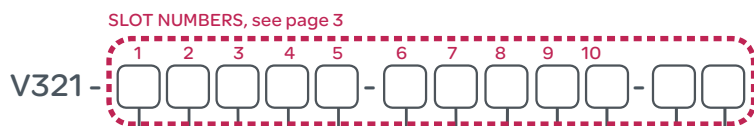

B = 3BIO+2Arc (3 x BI/BO, 2 x Arc sensor, T2, T3, T4)



G = 6DI+4DO (6 x DI, 4 x DO)



C = RS232+RJ  
(RS232 + Ethernet RJ-45 100 Mbs)



D = RS232+LC  
(RS232 + Ethernet LC 100 Mbs)



## Nominal supply voltage [V]

- A = Power A 110 - 240 V (80 - 265 V ac/dc, T1, A1, SF)
- B = Power B 24 - 48 V (18 - 60 V dc, T1, A1, SF)

## I/O Card I

- A = None
- B = 3BIO+2Arc (3 x BI/BO, 2 x Arc sensor, T2, T3, T4)
- C = F2BIO+1Arc (Fibre 2 x BI/BO, 1 x Arc loop sensor, T2, T3, T4)
- G = 6DI+4DO (6 x DI, 4 x DO)
- I = 10DI (10 x DI)

## I/O Card II

- A = None
- G = 6DI+4DO (6 x DI, 4 x DO)
- I = 10DI (10 x DI)

## I/O Card III

- A = None
- G = 6DI+4DO (6 x DI, 4 x DO)
- I = 10DI (10 x DI)

## I/O Card IV

- A = None
- D = 2IGBT (2 x IGBT High speed outputs), excludes I/O Card III, slot 4
- G = 6DI+4DO (6 x DI, 4 x DO)
- I = 10DI (10 x DI)

## Option card I

- A = None
- D = 4Arc (4 x Arc sensor)

## Option card II

- A = None
- D = 4Arc (4 x Arc sensor)

## Analog measurement card [A, V]

- A = 3L+U+Io (5/1A)

## Communication interface I

- A = None
- B = RS232 (RS232, IRIG-B)
- C = RS232+RJ (RS232, IRIG-B + Ethernet RJ-45 100 Mbs)
- D = RS232+LC (RS232, IRIG-B + Ethernet LC 100 Mbs)
- N = 2xRJ (Ethernet RJ 100 Mbs, RSTP)
- O = 2xLC (Ethernet LC 100 Mbs, RSTP)

## Communication interface II

- A = None
- B = RS232
- P = PP (Plastic / Plastic serial fibre)
- R = GG (Glass / Glass serial fibre)

## Display type

- A = 128x64 (128 x 64 LCD matrix)
- B = 128x128 (128 x 128 LCD matrix)
- C = 128x128Ext (128 x 128 LCD matrix, detachable)

## DI threshold voltage

- 1 = 24 V dc / 110 V ac
- 2 = 110 V dc / 220 V ac
- 3 = 220 V dc

## Accessories

Order Code	Explanation	Note
VAM 3L	Fiber sensor I/O unit (VAMP221 & 321)	3 fibre loops, 1 trip relay
VAM 3LX	Fiber sensor I/O unit (VAMP221 & 321)	3 fiber loops, 1 trip relay, adjustable sensitivity
VAM 4C	Current I/O unit (VAMP221 & 321)	3 current inputs, 1 trip relay
VAM 4CD	Current I/O unit (VAMP221 & 321)	3 current inputs, 1 trip relay, flush mounting
VAM 10L	Point sensor I/O unit (VAMP221 & 321)	10 sensor inputs, 1 trip relay
VAM 10LD	Point sensor I/O unit (VAMP221 & 321)	10 sensor inputs, 1 trip relay, flush mounting
VAM 12L	Point sensor I/O unit (VAMP221 & 321)	10 sensor inputs, 3 trip relays
VAM 12LD	Point sensor I/O unit (VAMP221 & 321)	10 sensor inputs, 3 trip relays, flush mounting
VAMP 4R	Trip multiplier relay	4 x NO, 4 x NC, 2 groups
VA 1 DA-6	Arc sensor	Cable length 6 m
VA 1 DA-20	Arc sensor	Cable length 20 m
VA 1 DA-6s	Arc sensor, shielded	Cable length 6 m
VA 1 DA-20s	Arc sensor, shielded	Cable length 20 m
VA1DA-6-HF	Arc sensor, halogen free	Cable length 6 m
VA 1 DA-20-HF	Arc sensor, halogen free	Cable length 20 m
VA 1 DP-5	Portable arc sensor	Cable length 5 m
VA 1 DP-5D	Portable arc sensor	Cable length 5 m
VA 1 EH-6	Arc sensor (pipe type)	Cable length 6 m
VA 1 EH-20	Arc sensor (pipe type)	Cable length 20 m
ARC-SLm-x	Fibre sensor, 8 000 lx	x = fibre length [m] <sup>(1)</sup>
SLS-1	Fibre joint SLS-1	Max one joint per fibre
VX001-xx	Modular cable VAM <-> VAM ( xx = cable length [m] )	Preferred cable lengths <sup>(2, 3)</sup>
VX031-5	Extension cable for VA1DP-5D	Cable length 5m
VX052-3	USB programming cable (VAMPSET)	Cable length 3 m
VX072	VAMP 300/321 profibus cable	Cable length 3 m
VYX001	Surface mounting plate for sensors	Z-shaped
VYX002	Surface mounting Plate for sensors	L-shaped
VYX 695	Projection for 300-series	Height 45 mm
VSE001PP	Fiber optic module (plastic - plastic)	RS-232 mode only
VSE002	RS485 module	RS-232 mode only
VPA 3CG	Profibus DP fieldbus option board	

Note 1:

Fibre lengths 1, 5, 10, 15, 20, 25, 30, 35, 40, 50 or 70 m

Note 2:

Cable lengths 1, 3, 5, 7, 10, 15, 20, 25 or 30 m

Note 3:

Cable lengths for detachable display: 1, 2, 3 or 5 m. Default is 2 m.

## Schneider Electric

35, rue Joseph Monier  
CS 30323  
F - 92506 Rueil Malmaison Cedex (France)  
Tel.: +33 (0) 1 41 29 70 00  
RCS Nanterre 954 503 439  
Capital social 896 313 776 €  
www.schneider-electric.com/energy-automation

As standards, specifications and designs change from time to time, please ask for confirmation of the information given in this publication.

Design: Schneider Electric Industries SAS - Sonovision  
Photos: Schneider Electric Industries SAS



This document has been printed on recycled paper.



## DEVICE TRACK RECORD

- Schneider Electric's VAMP Range specialises in protection relays, arc flash protection and measuring and monitoring units for power systems.
- VAMP's medium-voltage and sub-transmission protection relays are used in numerous applications, from overhead line feeders and substations to power plants and industrial power systems. Their unique integrated arc flash fault protection functionality enhances the safety of both people and property and has made VAMP a leading manufacturer in arc flash protection worldwide. VAMP products meet international standards and regulations.