



# Single-phase secondary test at voltage stage in VAMP relays

This document describes testing overvoltage and undervoltage stages with single phase test unit when the relay is set to voltage measurement mode “2LL + U<sub>0</sub>”.

## 1. U<sub>></sub> testing

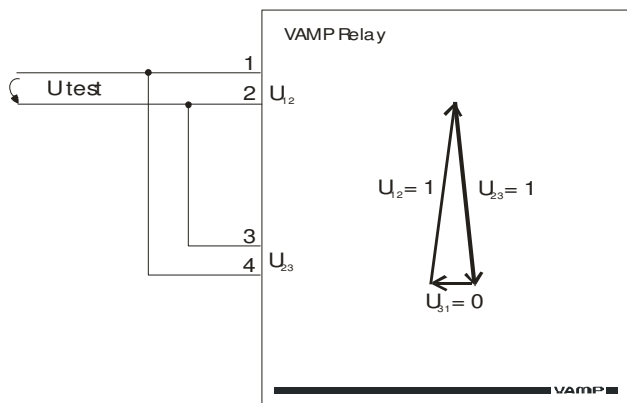

## 2. U<sub><</sub> testing

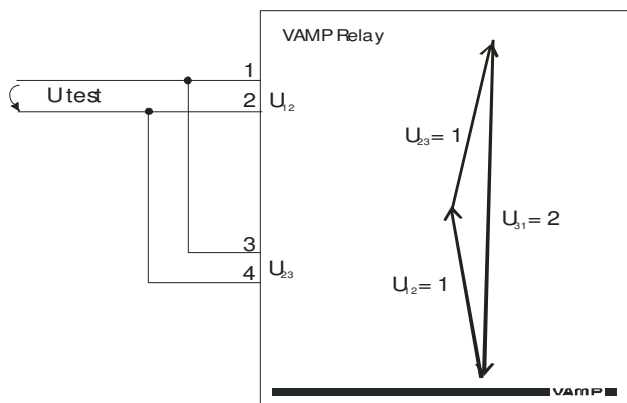

### Schneider Electric

35 rue Joseph Monier  
92506 Rueil-Malmaison  
FRANCE

Phone: +33 (0) 1 41 29 70 00  
Fax: +33 (0) 1 41 29 71 00

[www.schneider-electric.com](http://www.schneider-electric.com)

Publishing: 4/2013

© 2012 Schneider Electric Industries SAS - All rights reserved. Electrical equipment should be installed, operated, serviced, and maintained only by qualified personnel. No responsibility is assumed by Schneider Electric for any consequences arising out of the use of this material.